


DRAWING A-05 – Minimum Clearance to Service and Roadway

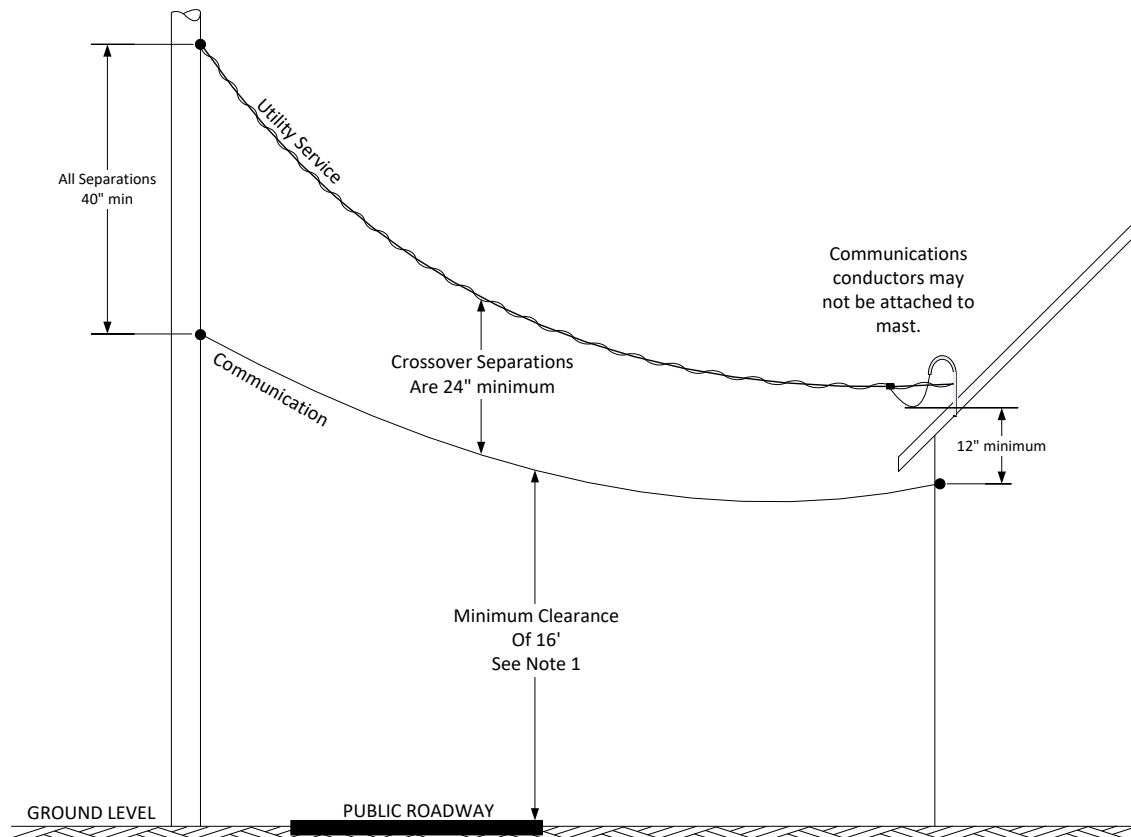

NOTES:

The NESC changes every five years, the clearances noted below have limiting conditions and may change. Refer to NESC 232 for the latest requirements.

1. Maintain minimum clearance
 - a. Railroads = 24 ft
 - b. Interstate = Contact WSDOT
 - c. Roads & Driveways = 16 ft
 - d. Walkways = 12 ft
2. NESC clearances on same supporting structure: Section 235 & 238.
3. NESC clearances on different supporting structures: Section 233.
4. Licensee's attachments on Poles including metal attachment clamps and bolts, metal crossarm supports, bolts and other equipment must be attached so as to maintain the minimum separations specified in the NESC and in the Licensor's drawings and specifications.
5. No communications power supply shall be mounted on Poles.