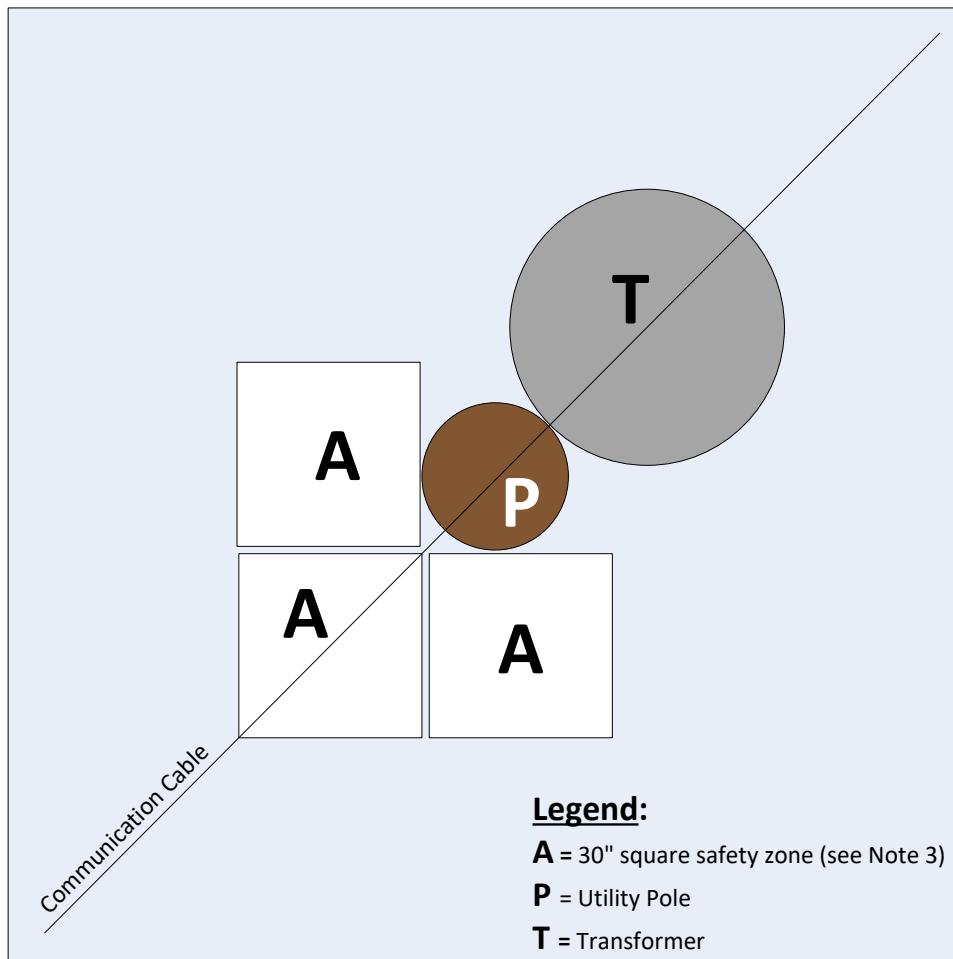

DRAWING A-07 – Climbing Space Requirements



NOTES:

1. For new cable installations locate cable on the same side of the Pole and the Licensor's lowest conductor.
2. Standoff brackets to mount cable to pole are not allowed without approval of the Licensor.
3. Climbing and workspace through the communication space shall extend from 40" below the lowest Communication cable to the top of the Pole.
4. On transformer Poles the Communication Service drops shall be located so that they originate from the messenger on the side of the Pole opposite the transformer.
5. Minimum clearances for climbing and working space shall be followed as per the National Electric Safety Code (NESC) Section 236.
6. No communications power supply shall be mounted on Poles.