


DRAWING A-02 – Overhead Minimum Clearances

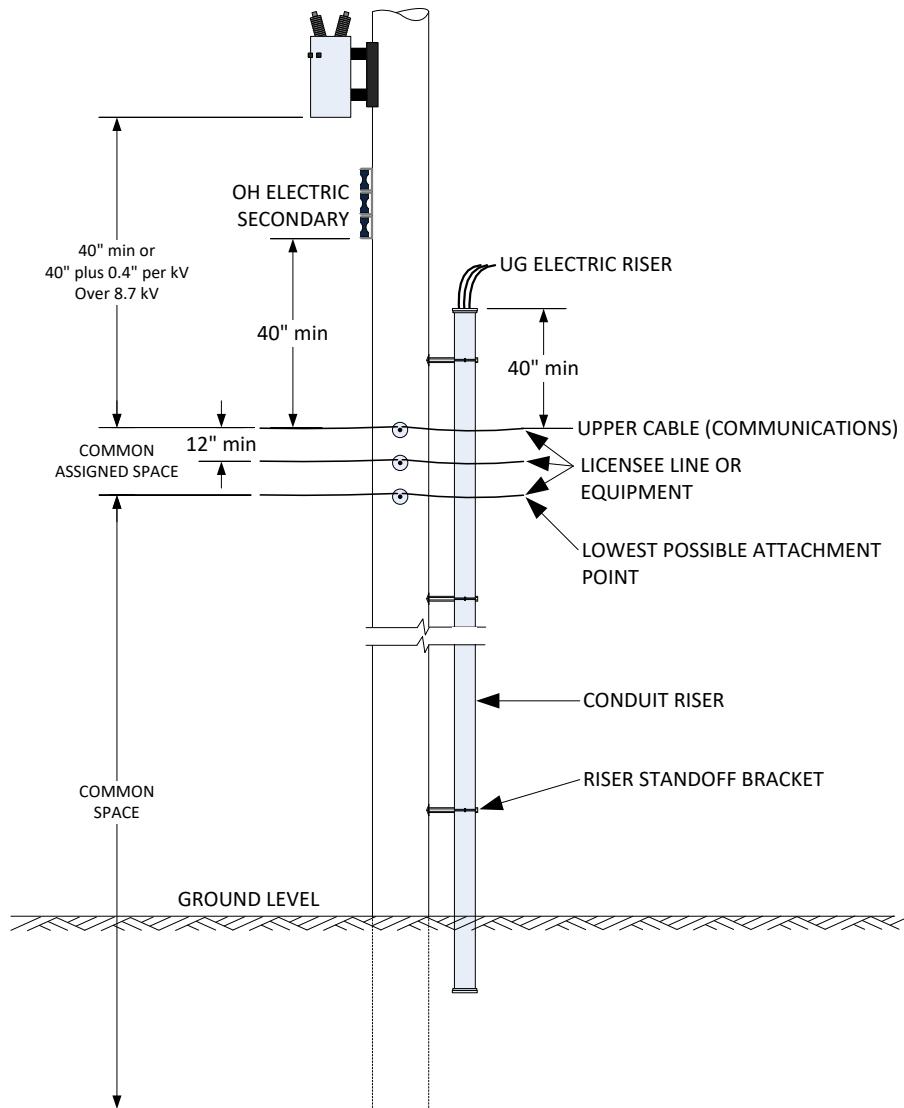

NOTES:

1. Separation between vertical runs and any metal parts or through bolts of power or Communications Facilities shall be at least 2" in any direction. Bolts shall have less than 2" exposed threads.
2. No communications power supply shall be mounted on Poles.
3. The above clearances may have to be increased to allow for code clearance requirement in mid span.
4. Licensee's attachments on Poles including metal attachment clamps and bolts, metal crossarm supports, bolts and other equipment must be attached so as to maintain the minimum separations specified in the NESC and in the Licenser's drawings and specifications.