


ONE LENGTH OF DUCTILE
IRON PIPE (CLASS 50) TO
SOLID BEARING GROUND
WHEN SPAN IS MORE THAN 4'

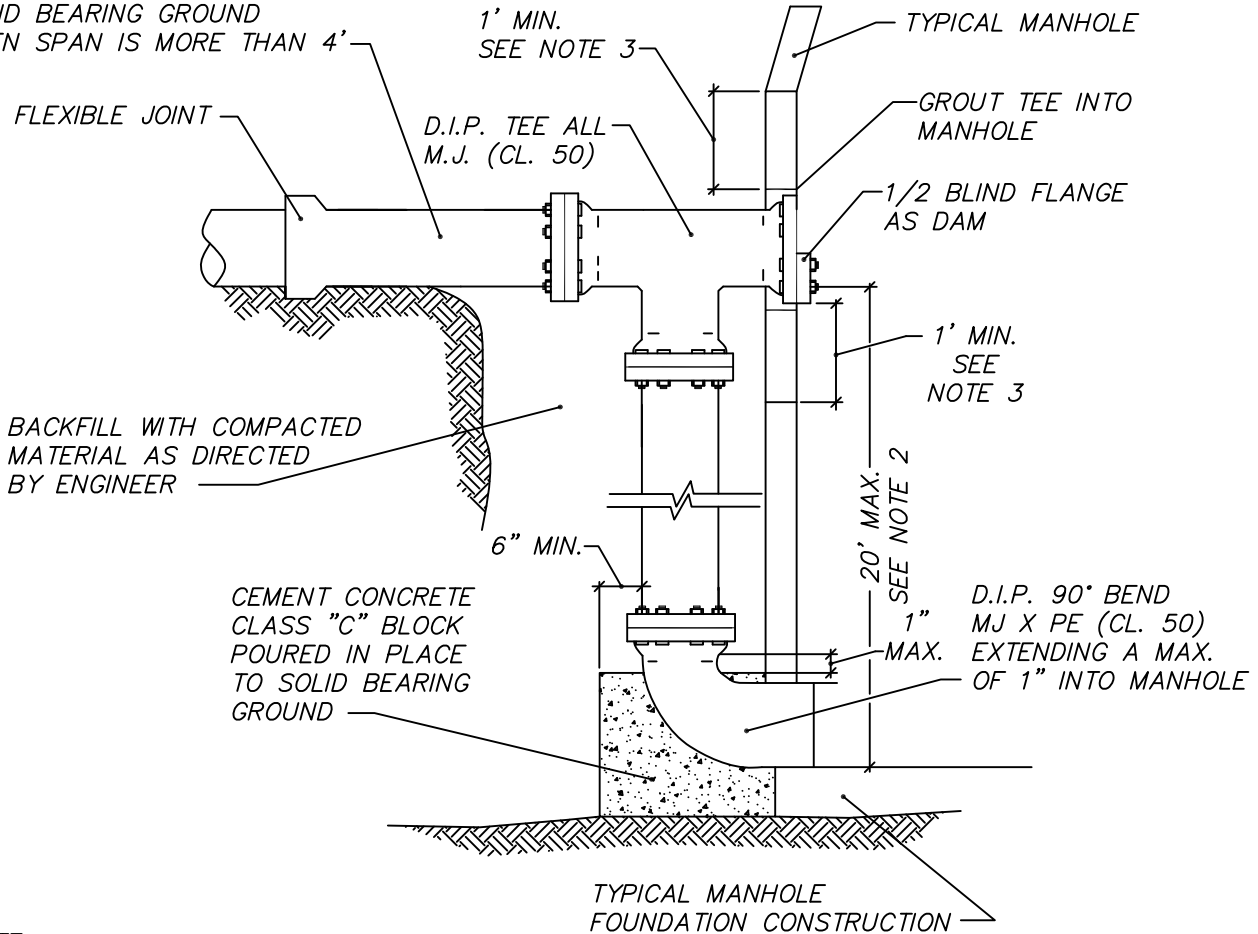

NOTE:

1. THE INTERIOR OF ALL DUCTILE IRON SHALL BE COATED WITH EPOXY OR TNEMEC 66.
2. DEPTHS OVER 20' MAY BE ALLOWED IF MEGA-LUG JOINTS ARE USED.
3. MAINTAIN A MINIMUM OF 1' BETWEEN MANHOLE JOINTS AND TEE.

APPROVED BY	REVISED DATE	CITY OF CENTRALIA	STD. PLAN NO.
CITY ENGINEER	06/2017	DROP CONNECTION	3-05
2022 Standard Drawings		OUTSIDE MANHOLE	