




PLAN VIEW  
SIDEWALK RAMP TYPE 2  
LAYOUT

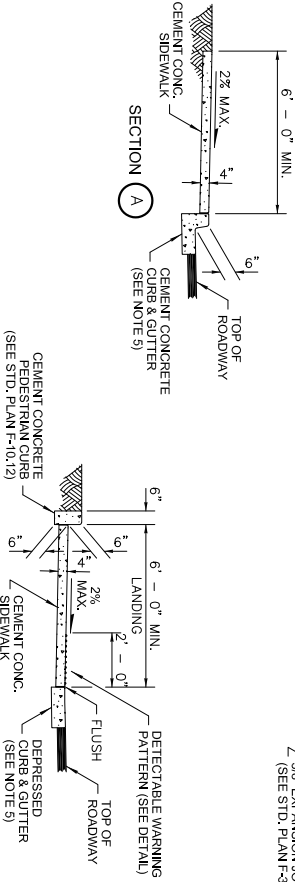

SECTION (B)

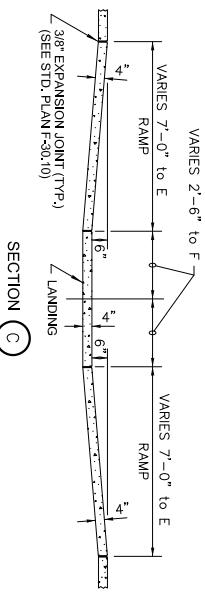

SECTION (C)

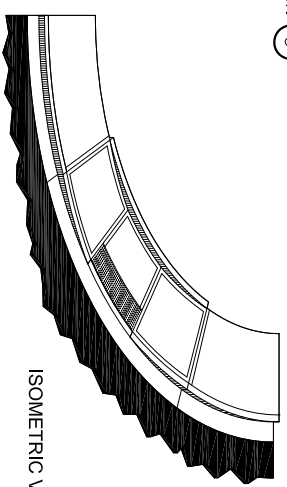


ISOMETRIC VIEW

RADIUS AT FACE OF CURB	E	F
20 FEET	10'-4 3/4"	3'-2 1/4"
30 FEET	8'-11 1/2"	3'-2 1/4"
40 FEET	8'-4 1/2"	2'-11 3/4"
50 FEET	8'-0 3/4"	2'-10 1/4"
60 FEET	7'-10 1/4"	2'-9 3/4"
70 FEET	7'-8 3/4"	2'-9"
80 FEET	7'-7 1/2"	2'-8 3/4"
90 FEET	7'-6 1/2"	2'-8 1/4"
100 FEET	7'-6"	2'-8"

INTERMEDIATE RADII CAN BE INTERPOLATED

# NOTES

1. The bottom of the ramp shall have a level area (not in excess of 2% in any direction), 4' x 4'.
2. The Type 2 Ramp Layout requires two (2) of this bid item: "Cement Conc. Stewalk Ramp Type 2." The bid item does not include the adjacent Curb (or Curb & Gutter), the Stewalk between Ramps, or the Cement Conc. Pedestrian Curb.
3. Ramp slopes shall not be steeper than 12H:1V.
4. Avoid placing drainage structures, junction boxes or other obstructions in front of ramp access areas.
5. Curb & Gutter is shown, see the Contract Plans for the curb design specified. See Standard Plan F-10.12 for curb details.
6. See Std. Plan F-30.10 for sidewalk joint placement and details.

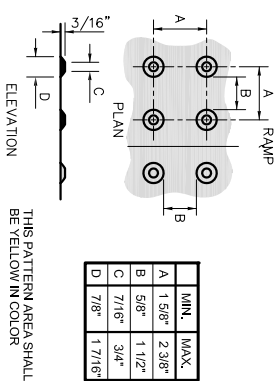

DETECTABLE WARNING PATTERN DETAIL

	MIN.	MAX.
A	1 5/6"	2 3/8"
B	5/8"	1 1/2"
C	7/16"	3/4"
D	7/8"	1 7/16"