



## LIVE TAP

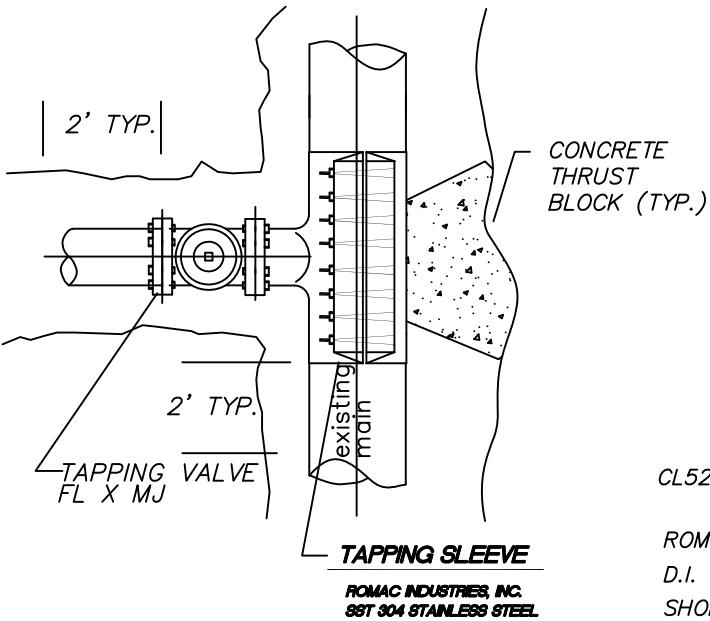


## CUT-IN-TEE

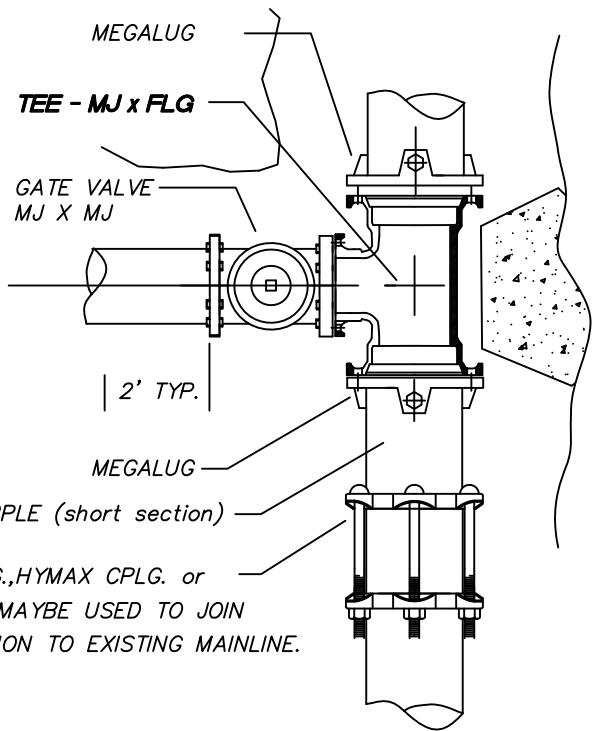

### NOTES:

1. 12 ML PLASTIC OR CONSTRUCTION FABRIC SHALL BE WRAPPED AROUND PIPE AND FITTINGS BEFORE THRUST BLOCKS ARE POURED.
2. SUPPORT VALVE AND SLEEVE CONTINUOUSLY THROUGH INSTALLATION.

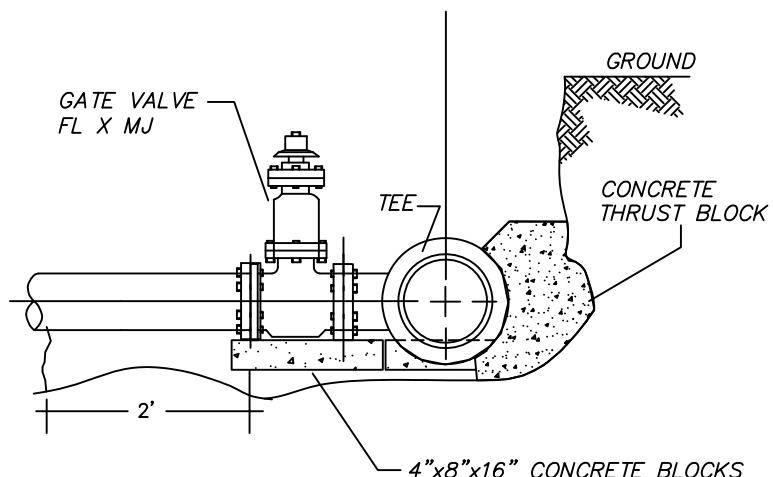

APPROVED BY	REVISED DATE	CITY OF CENTRALIA	STD. PLAN NO.
CITY ENGINEER	06/2017	LIVE TAP & CUT-IN-TEE STANDARD	2-11
2022 Standard Drawings			