


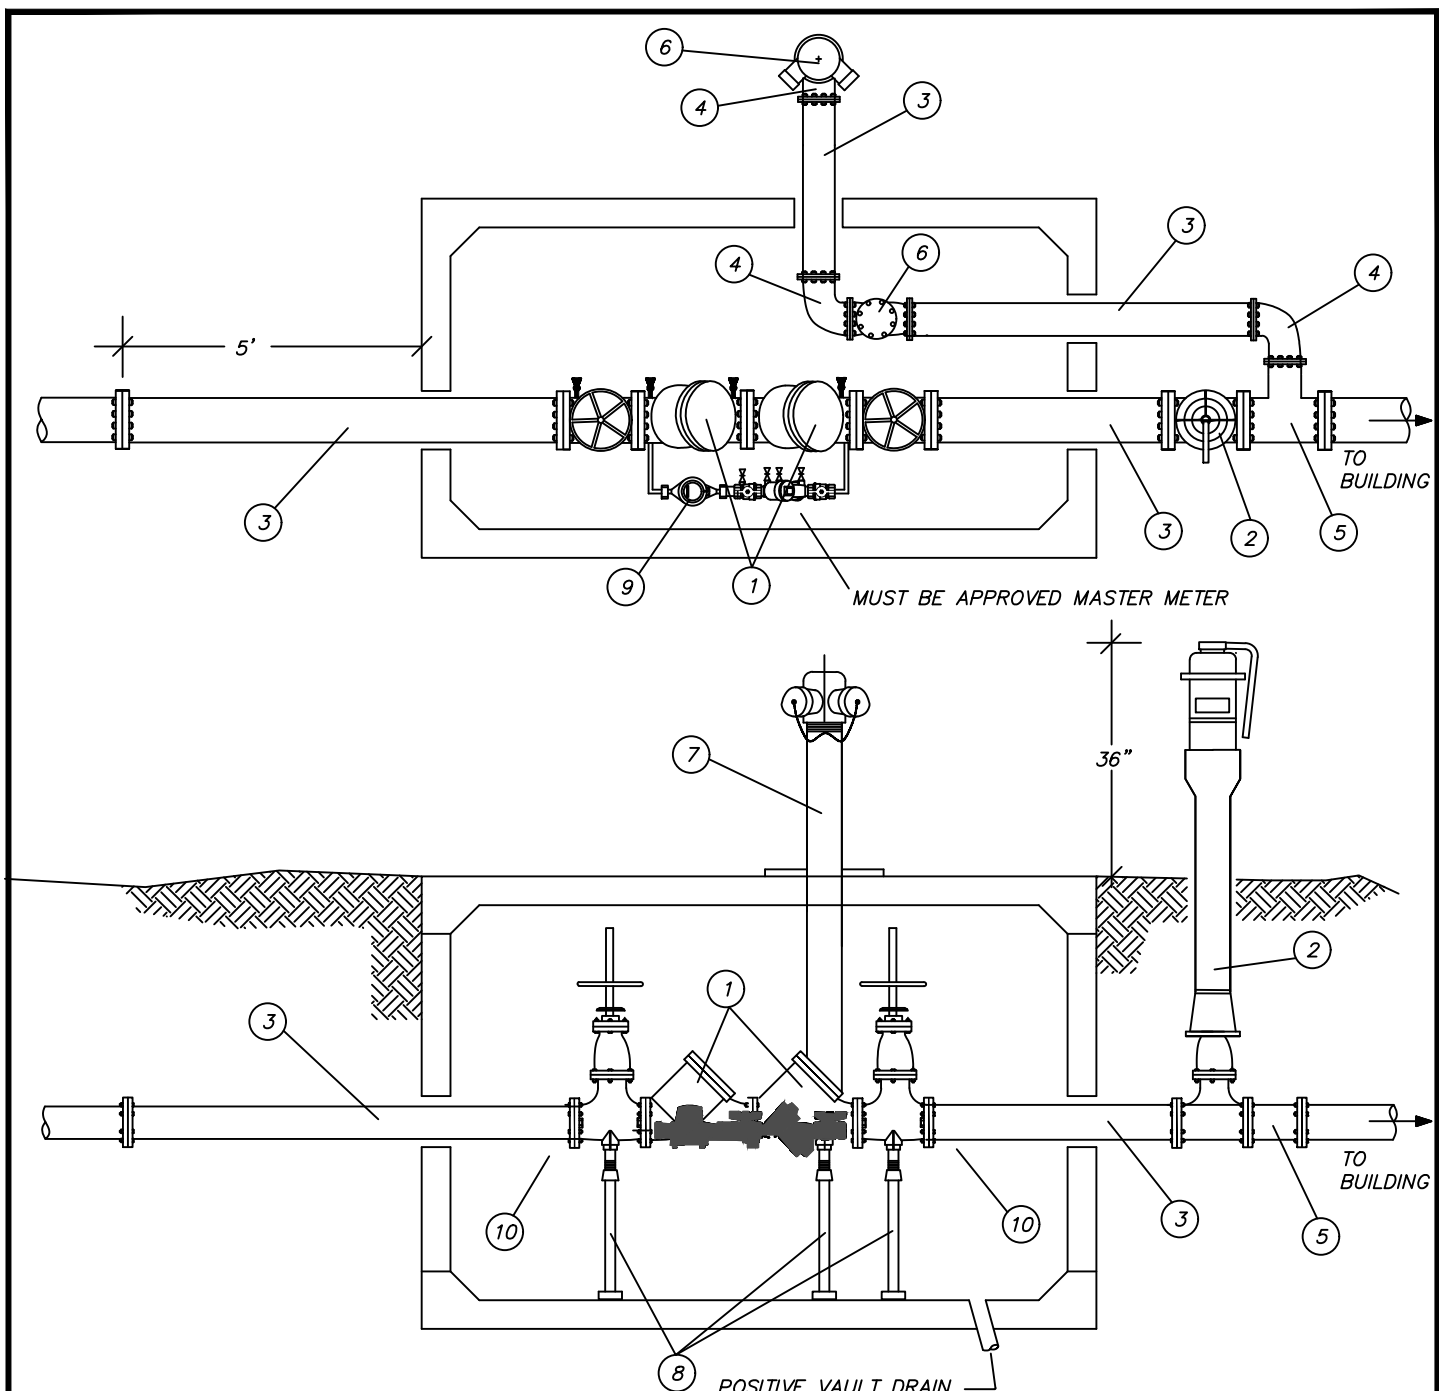


MATERIAL LIST:

1. DOUBLE (STATE APPROVED) CHECK DETECTOR ASSEMBLY
2. POST INDICATOR VALVE
3. CLASS 52 DI WALL PIPE FL X FL
4. CLASS 52 DI 90 deg. BEND FL X FL
5. CLASS 52 DI TEE FL X FL
6. SWING CHECK VALVE W/BALL DRIP ASSEMBLY
7. FIRE DEPARTMENT CONNECTION
8. SUPPORT STANDS (FOR ASSEMBLIES 2-1/2" AND LARGER)
9. DETECTOR METER
10. ROMAC RFCA

GENERAL NOTES:

- A. PIPE FROM VAULT TO BUILDING SHALL BE SAME AS MAIN TO VAULT
- B. TAMPER SWITCHES SHALL BE INSTALLED ON 1 & 3 CONNECTED TO BUILDING FIRE ALARM SYSTEM.
- C. ALL PIPING SHALL BE A MINIMUM OF 4" DIA. AS PER NFPA13.
- D. WHERE PIPING PASSES THROUGH CONC. WALL, PROVIDE 2" CLEARANCE WITH PIPE PENETRATION SEAL
- E. MUST BE IN VAULT IN OR ADJACENT TO R.O.W.

FIRE DEPT. CONNECTION

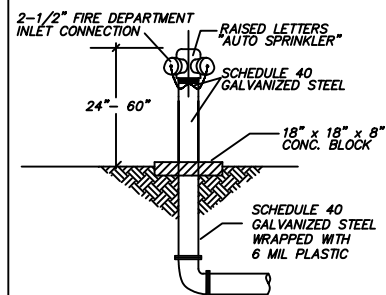

APPROVED BY	REVISED DATE	CITY OF CENTRALIA	STD. PLAN NO.
CITY ENGINEER	02/2024	DOUBLE CHECK DETECTOR ASSEMBLY W/FIRE DEPARTMENT CONNECTION	2-14
2022 Standard Drawings			1 of 2