


**GENERAL NOTES:**

- A. ADEQUATE SPACE CONSIDERATION FOR TESTING, REPAIR, AND MAINTENANCE.
- B. ADEQUATE DRAIN FOR RELIEF VALVE DISCHARGE.
- C. ADEQUATE FREEZE PROTECTION SHALL BE PROVIDED WHEN NEEDED.
- D. NO VERTICAL OR BELOW GROUND INSTALLATIONS ACCEPTABLE.
- E. BE AWARE OF THERMAL EXPANSION DANGER.

AN ENCLOSURE MAY BE USED FOR FREEZE PROTECTION  
( SEE GENERAL NOTES )

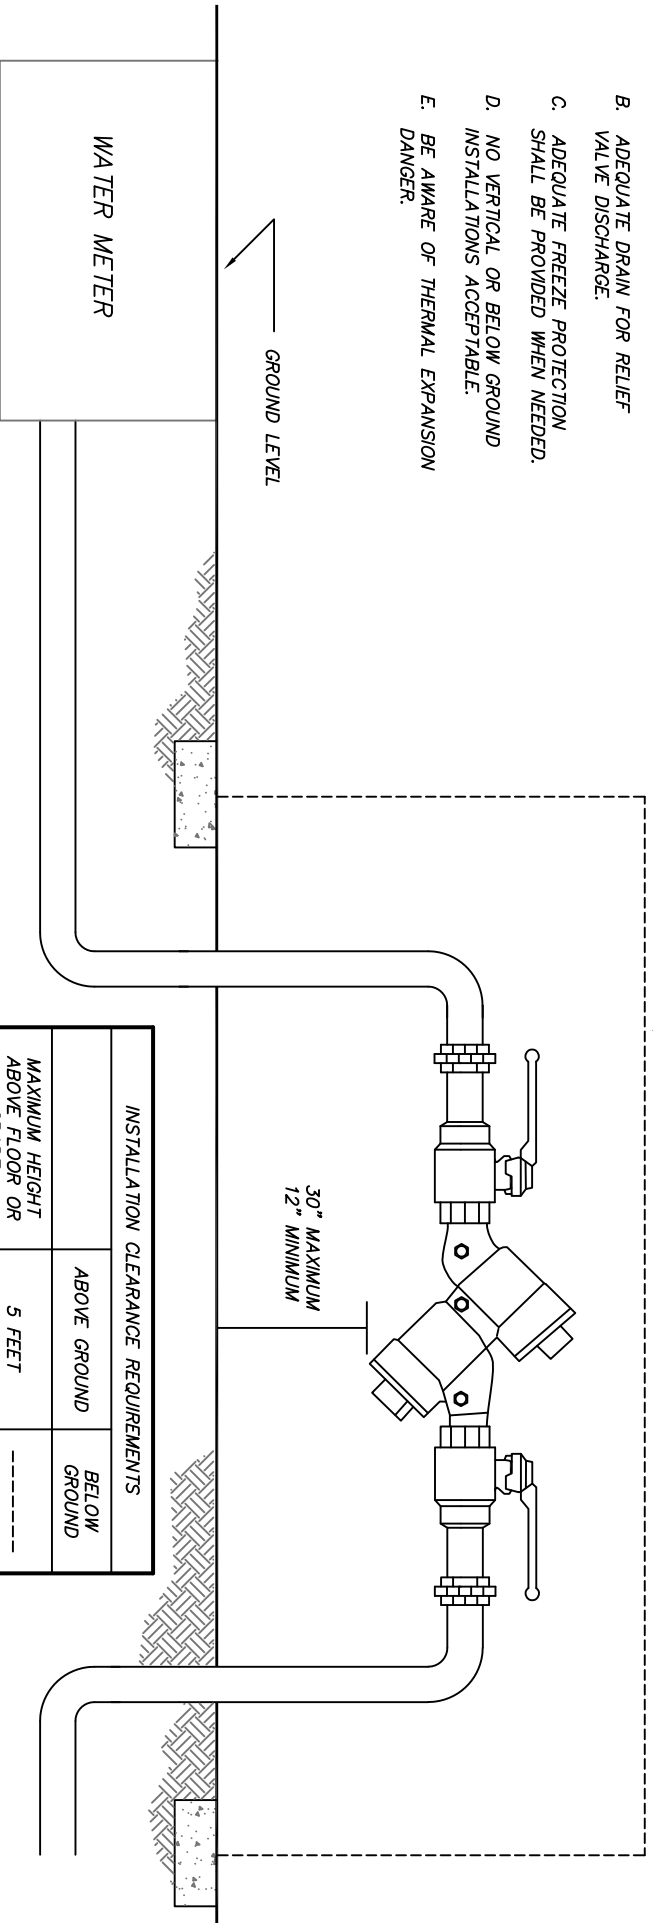

INSTALLATION CLEARANCE REQUIREMENTS		
	ABOVE GROUND	BELOW GROUND
MAXIMUM HEIGHT ABOVE FLOOR OR GRADE	5 FEET	-----
MINIMUM SIDE CLEARANCE	ADEQUATE*	ADEQUATE*
MINIMUM CLEARANCE BELOW ASSEMBLY	ADEQUATE*	6 INCHES
MINIMUM END CLEARANCE	ADEQUATE*	ADEQUATE*
MINIMUM CLEARANCE ABOVE FULLEST OPENING OF SOV	ADEQUATE*	ADEQUATE*

\*CONSULT THE WATER PURVEYOR FOR INTERPRETATION OF WHAT IS ADEQUATE

APPROVED BY	REVISED DATE	CITY OF CENTRALIA
CITY ENGINEER	06-2017	<b>REDUCED PRESSURE BACKFLOW ASSEMBLY</b> ( Above Ground Installation )
2022 Standard Drawings		

2-17	STD. PLAN NO.
------	---------------