


## METER BOX ASSEMBLY

Carson Heavy Wall 1324 MSBC  
DUCTILE IRON COVER w/ FLIP READER LIDS, # 1324 MSBC

### DOUBLE STRAP SERVICE SADDLE

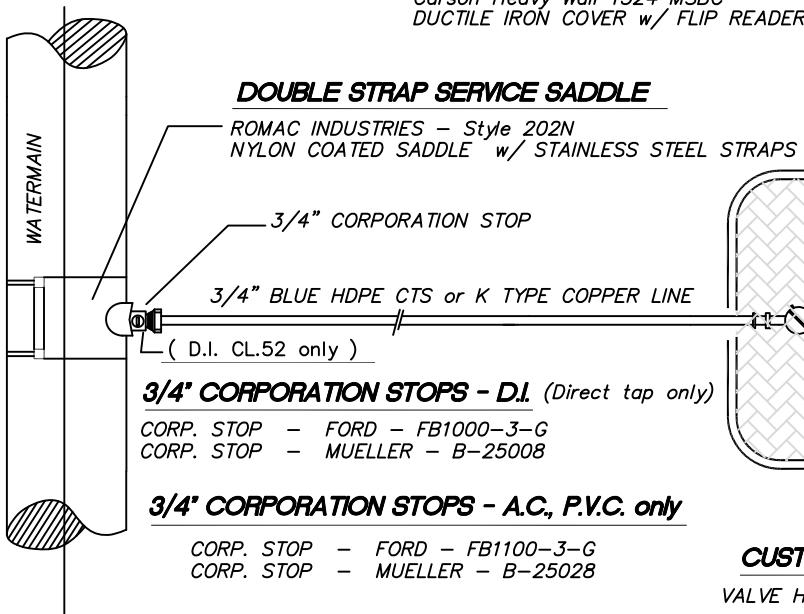

### 3/4" CORPORATION STOPS - D.I. (Direct tap only)


CORP. STOP - FORD - FB1000-3-G  
CORP. STOP - MUELLER - B-25008

### 3/4" CORPORATION STOPS - A.C., P.V.C. only

CORP. STOP - FORD - FB1100-3-G  
CORP. STOP - MUELLER - B-25028


### CUSTOMER SIDE HANDLE

VALVE HANDLE - FORD - HB-34

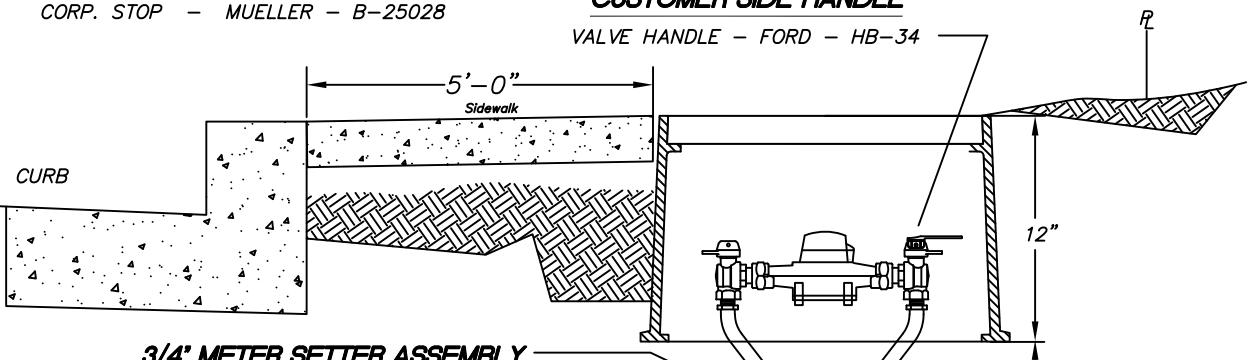

### 3/4" METER SETTER ASSEMBLY

METER SETTER - FORD - VBB72-15W-11-33-NL

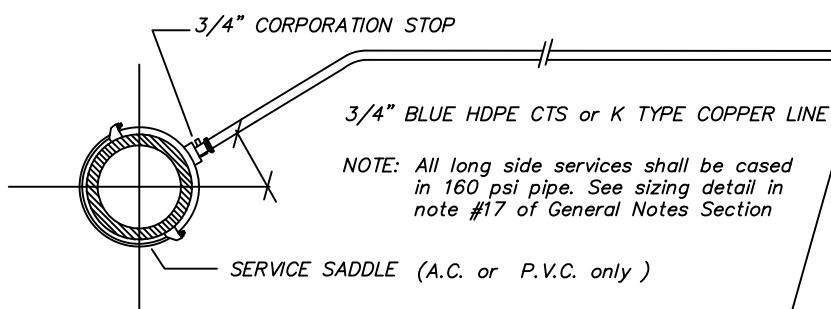

### 3/4" Grip Joint Coupler

GRIP JOINT COUPLING - FORD - C84-33-G

### NOTES:

1. ALL SERVICE SADDLES SHALL HAVE RUBBER GASKET, I.P. THREADS AND NYLON COATED.
2. IN APPROVED SOIL SENSITIVE AREAS HDPE MAINS AND SERVICE LINES ARE REQUIRED. A TONING (tracer) WIRE, UL LISTED, TYPE UF, SOLID CORE, 12 GAUGE INSULATED COPPER IS REQUIRED. AN IDEAL TWISTER DB PLUS WIRE CONNECTOR, MODEL 60 IS REQUIRED TO CONNECT TRACER WIRES TOGETHER (i.e. tracer wire extension from spool to spool, service to main, main to main at intersections, and hydrant to main installations). Blue HDPE CTS shall be substituted for type K copper in service lines.
3. DUCTILE IRON MAINS SHALL BE DIRECT TAPPED ONLY
4. ASBESTOS CEMENT (A.C.) AND PVC MAINS SHALL REQUIRE A SADDLE FOR TAPPING
5. STAINLESS STEEL PIPE STIFFENERS ARE REQUIRED WHERE HDPE PIPE IS USED

APPROVED BY

REVISED DATE

**CITY OF CENTRALIA**

STD. PLAN NO.

CITY ENGINEER

02/2020

**3/4" SINGLE METER SERVICE  
STANDARD**

2-02