


## DOUBLE STRAP SERVICE SADDLE

ROMAC INDUSTRIES - Style 202N  
NYLON COATED SADDLE w/ STAINLESS STEEL STRAPS  
NOTE: (ALL SADDLES WITH 1.5" AND 2" TAPS ARE TO BE TAPPED WITH IRON PIPE THREAD)

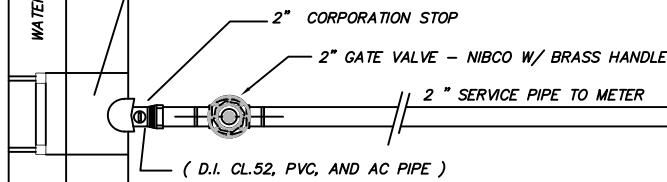


## 2" CORPORATION STOPS

CORP. STOP - FORD - FB500-6  
CORP. STOP - MUELLER - B 2969

## METER BOX ASSEMBLY

Carson Heavy Wall 1730 MSBC  
DUCTILE IRON COVER w/ FLIP READER LIDS, # 1730 MSBC

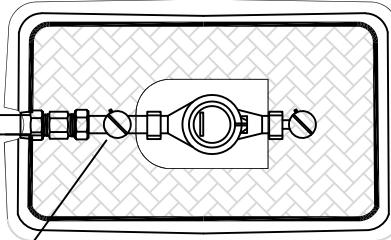


## CUSTOMER SIDE HANDLE

VALVE HANDLE - FORD - HB-67

## 2" METER SETTER ASSEMBLY

METER SETTER - FORD - VBB77-15B-11-77-NL

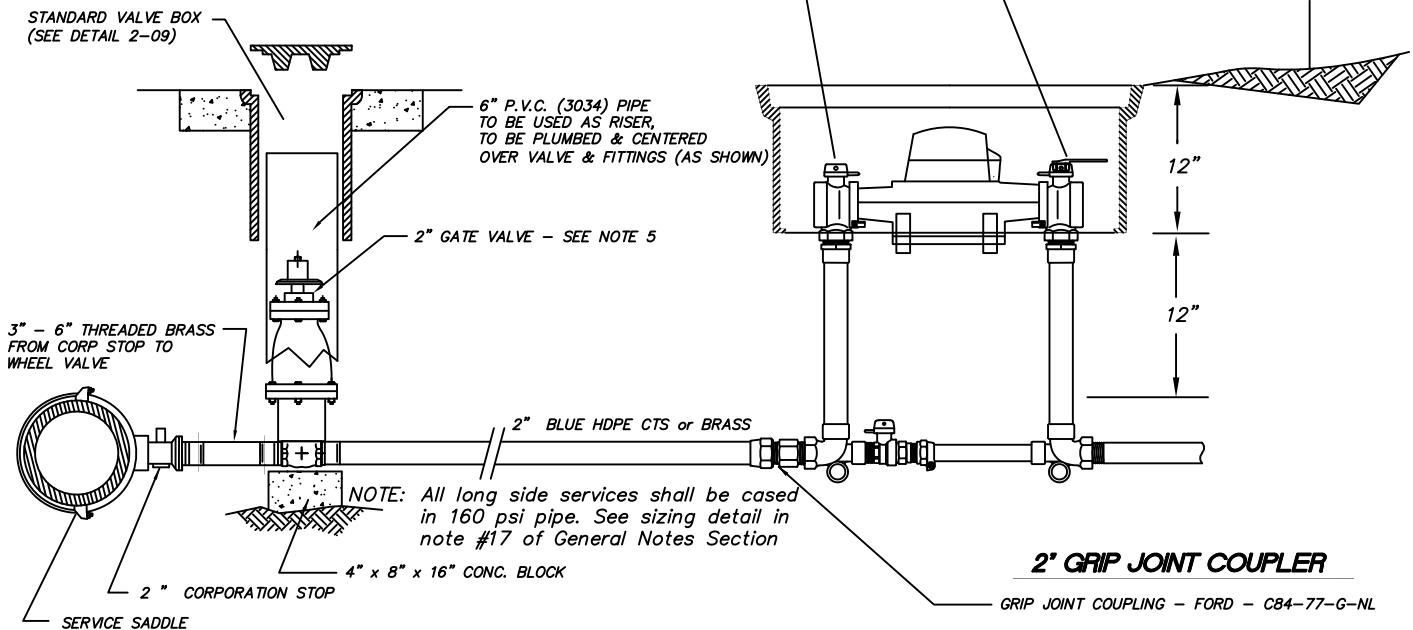

## NOTES:

1. ALL SERVICE SADDLES SHALL HAVE RUBBER GASKET, I.P. THREADS AND NYLON COATED. ALL 1.5" AND 2" SERVICE LINES WILL BE SADDLED.
2. IN APPROVED SOIL SENSITIVE AREAS HDPE MAINS AND SERVICE LINES ARE REQUIRED. A TONING (tracer) WIRE, UL LISTED, TYPE UF, SOLID CORE, 12 GAUGE INSULATED COPPER IS REQUIRED. AN IDEAL TWISTER DB PLUS WIRE CONNECTOR, MODEL 60 IS REQUIRED TO CONNECT TRACER WIRES TOGETHER (i.e. tracer wire extension from spool to spool, service to main, main to main at intersections, and hydrant to main installations). Blue HDPE CTS shall be substituted for type K copper in service lines.
3. ALL THREAD FITTING CONNECTIONS SHALL BE DRESSED WITH AN APPROVED JOINTING COMPOUND
4. ANTI-SEIZE SHALL BE USED ON ALL BOLT THREADS
5. 2" GATE VALVE - M&H AWWA C509 RESILIENT WEDGE GATE VALVE 4067-07 w/ 2" SQUARE NUT
6. STAINLESS STEEL PIPE STIFFENERS ARE REQUIRED WHERE HDPE PIPE IS USED

APPROVED BY	REVISED DATE	CITY OF CENTRALIA	STD. PLAN NO.
CITY ENGINEER	06/2023	2" SINGLE METER SERVICE STANDARD	
2022 Standard Drawings			2-05