


ONE LENGTH OF DUCTILE IRON PIPE (CLASS 50) TO SOLID BEARING GROUND WHEN SPAN IS MORE THAN 4'

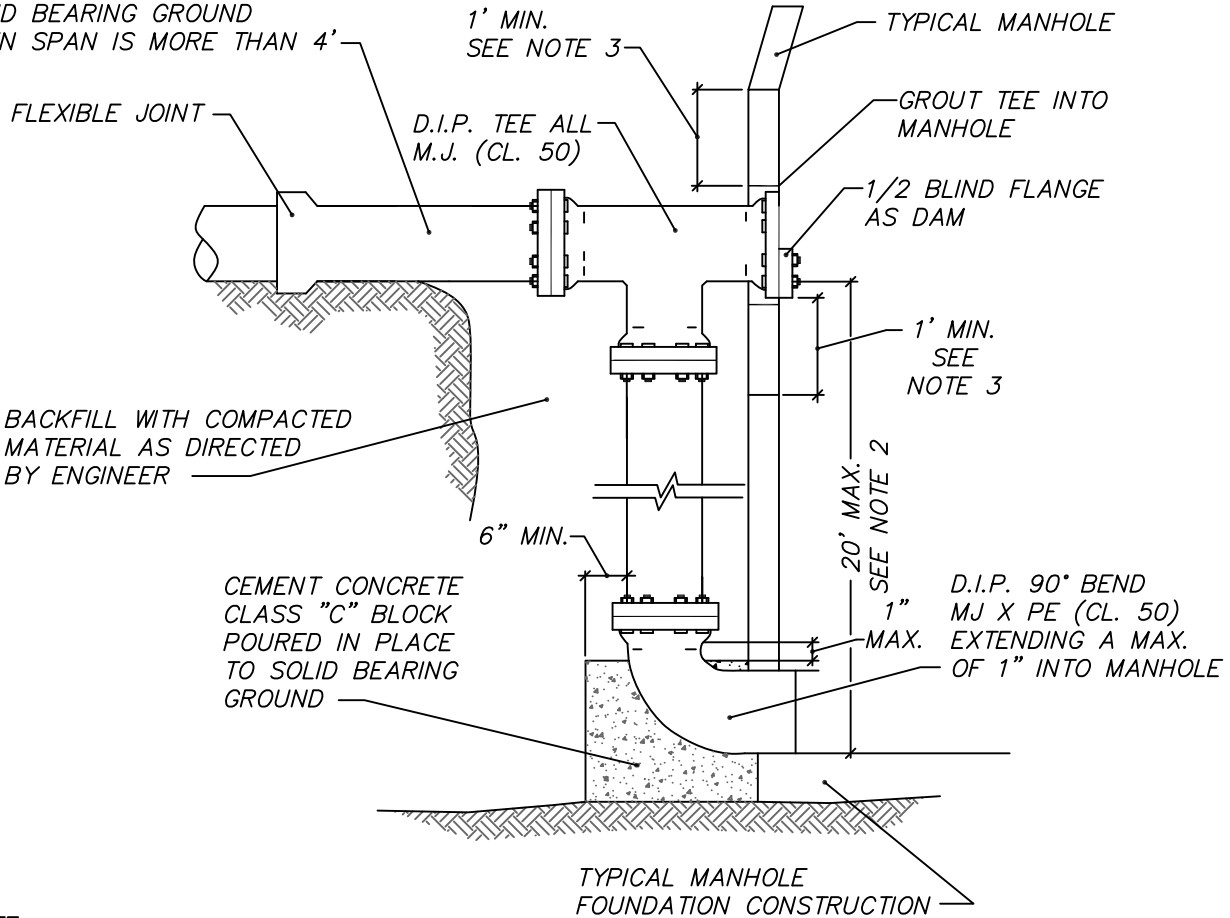

**NOTE:**

1. THE INTERIOR OF ALL DUCTILE IRON SHALL BE COATED WITH EPOXY OR TNEMEC 66.
2. DEPTHS OVER 20' MAY BE ALLOWED IF MEGA-LUG JOINTS ARE USED.
3. MAINTAIN A MINIMUM OF 1' BETWEEN MANHOLE JOINTS AND TEE.

APPROVED BY	REVISED DATE	<b>CITY OF CENTRALIA</b>	STD. PLAN NO.
CITY ENGINEER	<b>06/2017</b>	<b>DROP CONNECTION OUTSIDE MANHOLE</b>	<b>3-05</b>